

Heatcraft Coil Certified Drawing


Modular Auxiliary Removable Coil CP-1191-J

Customer _____ Customer P.O. Number _____
 Job _____
 Written by _____ Date _____
 Approved by _____ Date _____

#	TAG	QTY	MODEL NUMBER						UNIT HAND
			TYPE	FPI	ROWS	FIN	FH (IN)	FL (IN)	
1									Right, Left
2									
3									
4									

OPTIONAL MATERIALS OF CONSTRUCTION		
#	CASING MATERIAL 16 Gauge Galv. or 304 St. Stl	VERTICAL FILTER RACK (Internal)
1		<input type="checkbox"/>
2		<input type="checkbox"/>
3		<input type="checkbox"/>
4		<input type="checkbox"/>

STANDARD MATERIALS OF CONSTRUCTION	
Drain Pan	0.060+Stainless Steel
Drain	Sch. 40 Stainless Steel
Insulation	0.75+x 1.50+Density
Base	Galvanized Steel
Lifting Lugs	0.25+x 1.50+x 2.00+Angle Iron

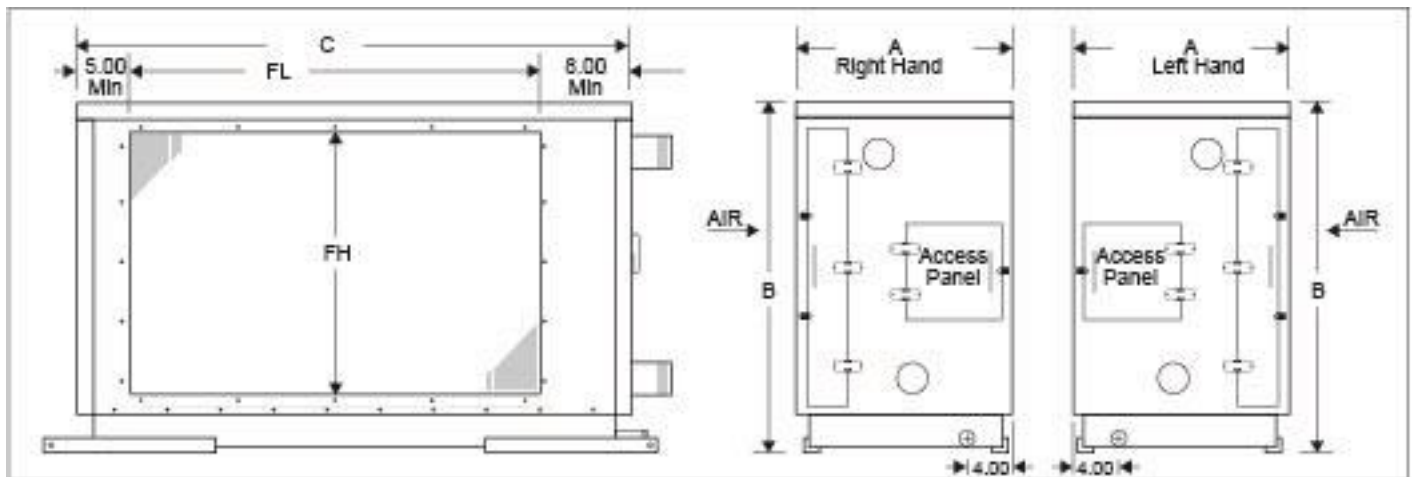

#	DIMENSIONAL DATA				
	Base 3% or 5%	Drain	A	B	C
1		See Note 4		See Note 5	
2					
3					
4					

NOTES :

GENERAL NOTES

1. Connection locations dependent on coil.
2. Coil mounted flush with side of cabinet using 0.25+20 self-tapping screws.
3. Coils mounted to entering air side of cabinet.
4. If Base = 3+- Drain = 1+, If Base = 5+- Drain = 1.25+
5. If Base = 3+. B = FH + 9+. If Base = 5+. B = FH + 11+
6. Add 6 inches to A dim for filter rack door (std 2+filter rack)
7. If Base = 3+ and Dim B is less than 27+ or Base = 5+ and Dim B is less than 29+. no access panel supplied.
8. Drain pan dual sloped toward drain.